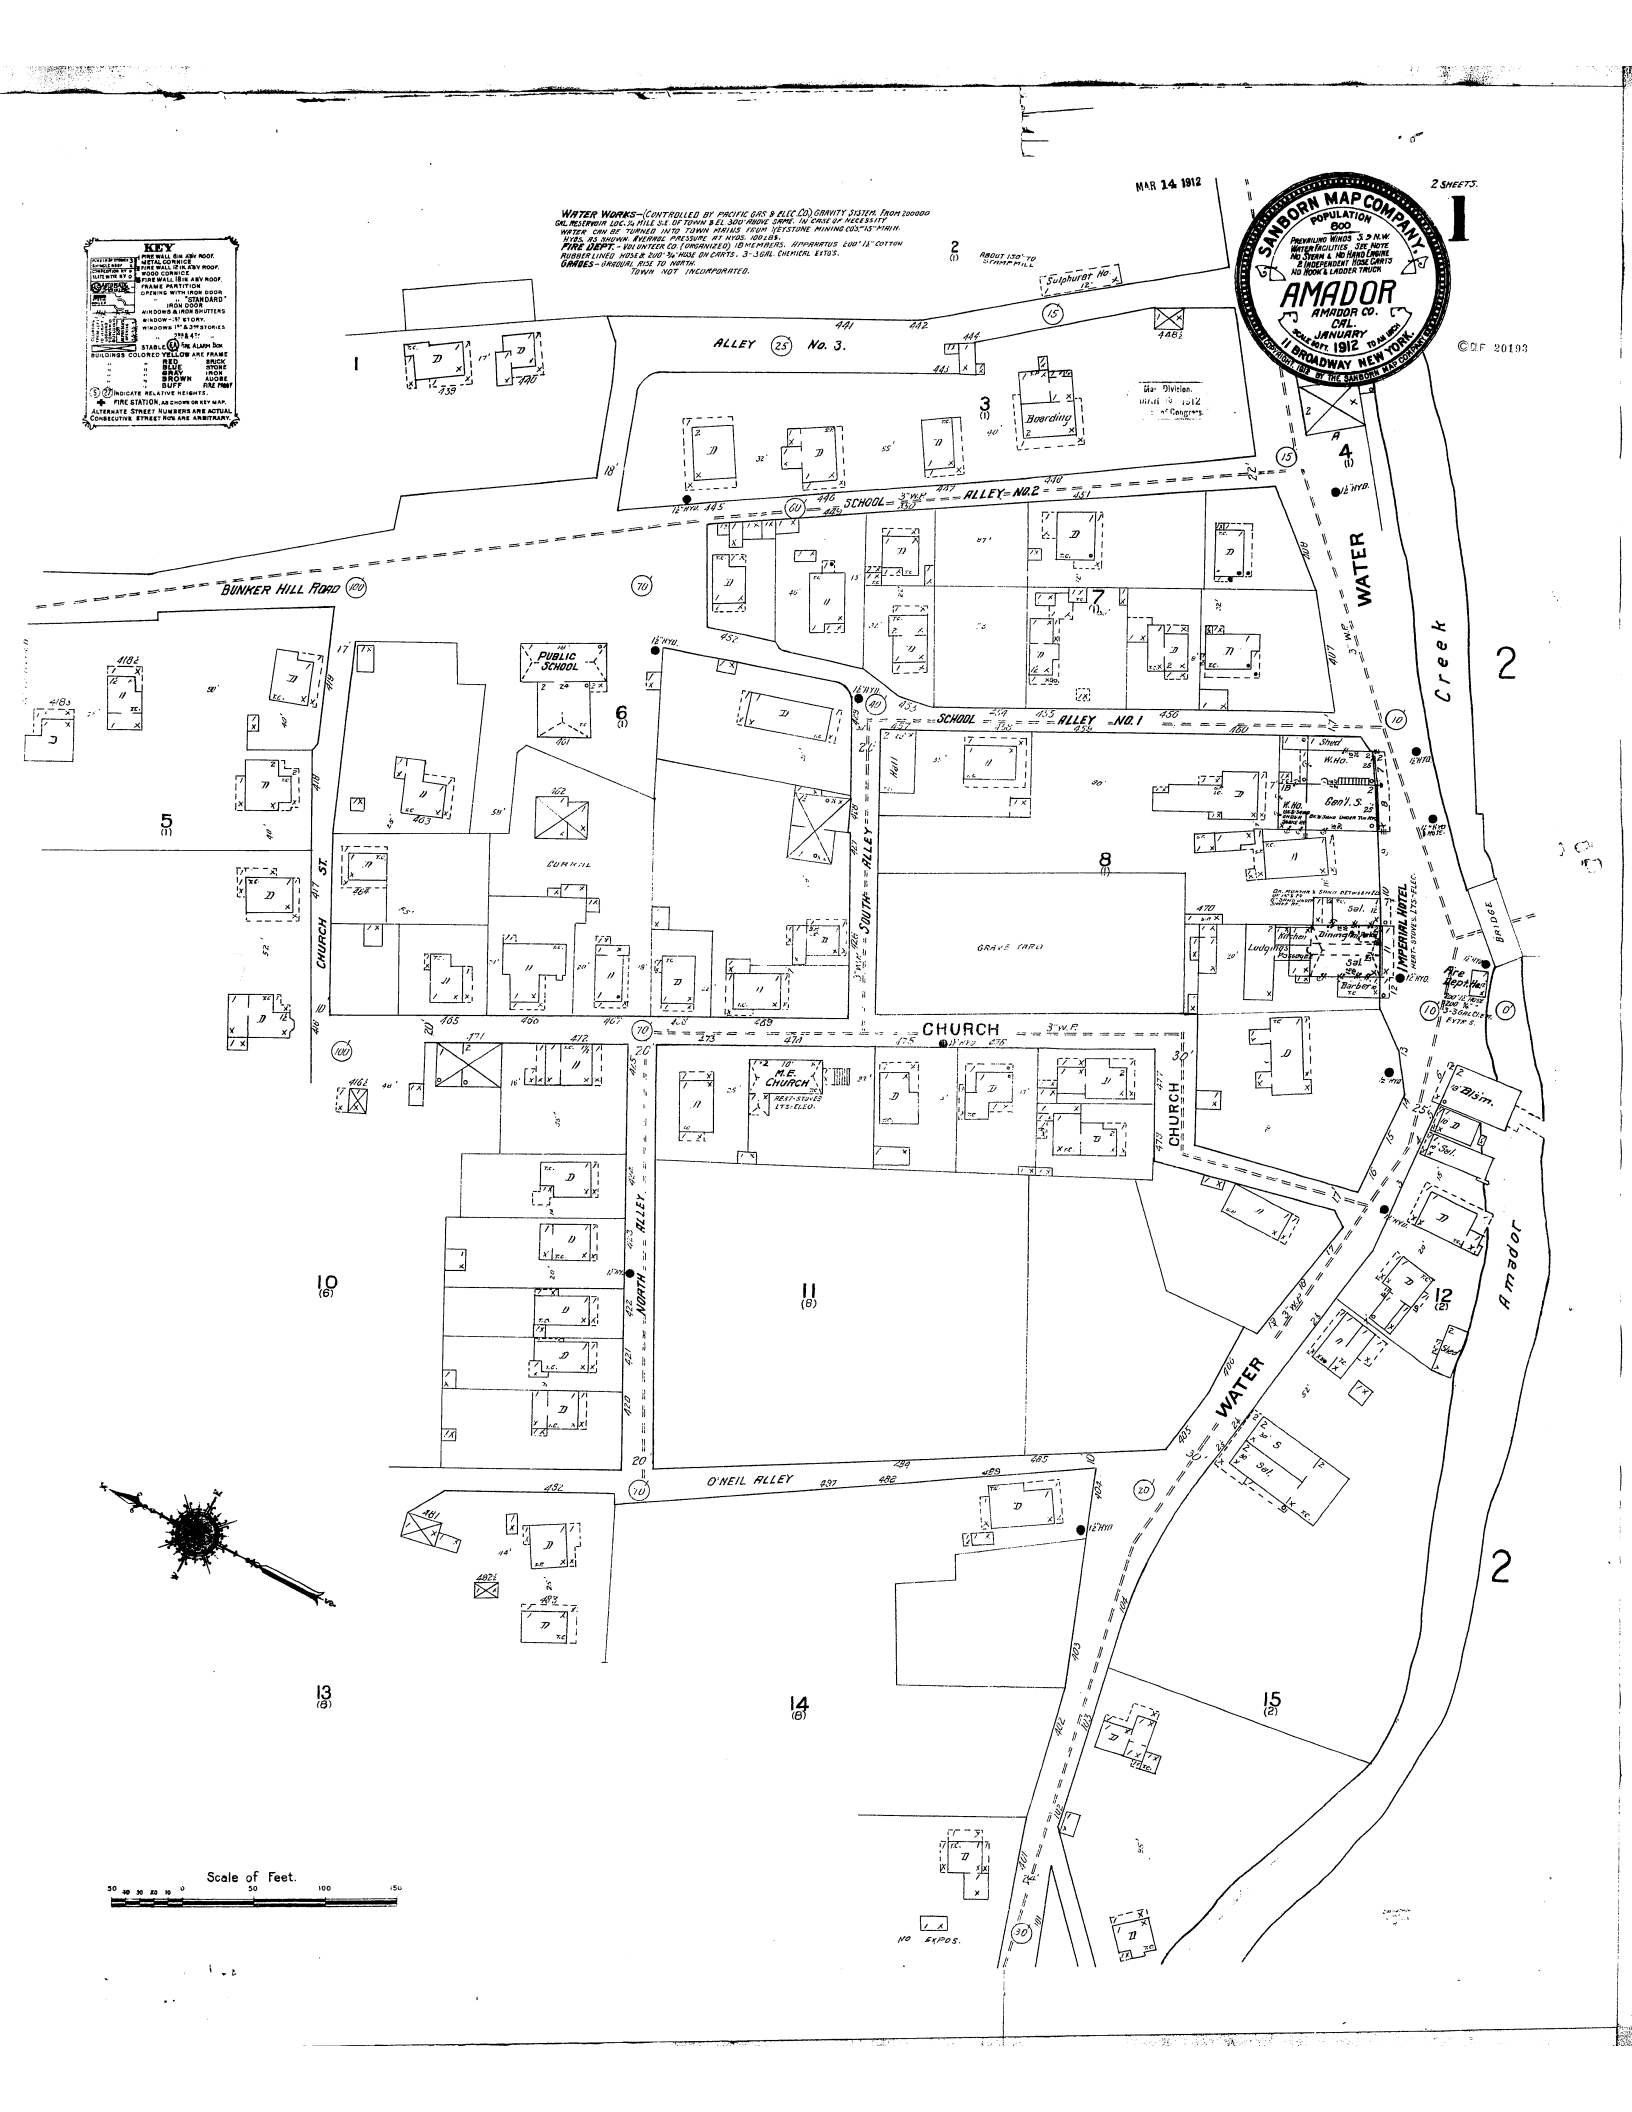
MAR 14 1912
2 SHEETS.
1
SANBORN MAP COMPANY.
POPULATION 800
PREVAILING WINDS S. & N.W.
WATER FACILITIES - SEE NOTE
NO STEAM & NO HAND ENGINES
2 INDEPENDENT HOSE CARTS
NO HOOK & LADDER TRUCK
AMADOR
AMADOR CO. CAL.
JANUARY 1912 TO JAN 1913
11 BROADWAY NEW YORK
©DF 20193
WATER WORKS- (CONTROLLED BY PACIFIC GAS & ELEC CO) GRAVITY SYSTEM. FROM 200000 GAL RESERVOIR LOC. IN HILL S.E. OF TOWN & EL 320' ABOVE CAMP. IN CASE OF NECESSITY WATER CAN BE TURNED INTO TOWN MAINS FROM KEYSTONE MINING CO'S 15" MAIN.
MAINS 8" AVERAGE PRESSURE 97 HYDS. 100 LBS.
FIRE DEPT. - VOLUNTEER CO (ORGANIZED) 18 MEMBERS. APPARATUS 200' 1½" COTTON RUBBER LINED HOSE & 200' ¾" HOSE ON CARTS. 3-3 GAL CHEMICAL EXTGS.
GRADES - HARBOUR, RISE TO NORTH.
TOWN NOT INCORPORATED.
KEY
FIRE WALL & IRON ROOF.
METAL CORNICE.
FIRE WALL & IRON ROOF.
SHUTTERS ON 2 & 3 STORY.
FIRE WALL & IRON ROOF.
FRAME PARTITION.
OPENING WITH IRON DOOR.
"STANDARD"
IRON DOOR.
WINDOWS & IRON SHUTTERS.
WINDOW-1ST STORY.
WINDOWS 1ST & 2ND STORIES.
STABLE (A) Reg. ALARM Box.
BUILDINGS COLORED YELLOW ARE FRAME
RED BRICK.
BLUE STONE.
GRAY IRON.
BROWN ADOBE.
BUFF FIRE PROOF.
(3) (2) INDICATE RELATIVE HEIGHTS.
FIRE STATION, AS SHOWN ON KEY MAP.
ALTERNATE STREET NUMBERS ARE ACTUAL CONSECUTIVE STREET NOS ARE ARBITRARY.
ALLEY (25) No. 3.
SCHOOL ALLEY NO. 2
SCHOOL ALLEY NO. 1
BUNKER HILL ROAD
CHURCH ST.
CHURCH
SOUTH ALLEY
NORTH ALLEY
O'NEIL ALLEY
WATER
Creek
Amador
PUBLIC SCHOOL
M.E. CHURCH
IMPERIAL HOTEL
GRAVE (RP.)
Boarding
Sulphurat Ho.
Fire Dept. Hse.
Scale of Feet.
50 40 30 20 10 0 50 100 150
NO EXPOS.